MODULUS

Serial Communications Module - 1120R

Modulus Serial Communications modules can interconnect Modulus SCADA controllers and 3rd party devices by hardwired connections or external radios and modems. Standard communications protocols such as Modbus, DF1, SDI-12 and Ethernet IP, as well as Ethernet-Serial bridging and Ethernet Routing are supported.

Modulus Serial Communications modules have built-in analog and digital I/O for temperature control, valve monitoring and control, tank level monitoring, and pump control applications such as wells, lift stations and booster pumping stations They can also serve as communications concentrators with intelligent links to smart monitoring and control devices such as variable frequency drives and power meters.

Modulus Serial Communications modules have two general purpose serial ports that support multiple types of interfaces; RS-232, RS-485 (2-wire), RS-422 (4-wire), and SDI-12 .The buss port may also be used as a general purpose RS-485 serial port if not used for high-speed bus communications with other Modulus I/O modules.

STANDALONE OPERATION

Modulus Serial Communications modules can serve as standalone devices with SCADA communications, local and web human machine interfaces (HMIs), historical trending and data logging, alarming, reporting, and programmable logic.

COMMUNICATIONS

Serial communications modules have an Ethernet port and two serial ports to communicate directly with Modbus devices and Allen Bradley PLCs. The module can serve as a communications concentrator or master controller. Ethernet to Serial bridging, and Ethernet routing to other Modulus modules' Ethernet ports, is also supported.

GRAPHICAL, MOBILE, AND LOCAL HMIs


Configurable graphical web and mobile device interfaces are built into the serial communications modules. The front panel display can also be customized to show live process values and states, and make setting changes.

HISTORICAL TRENDING AND EVENT LOGGING

Serial communications modules have an internal solid state flash disk, as well as a micro SD memory card slot to record over 100 years of data! Use built-in web tools to retrieve and display historical trend and event data and extract it as spreadsheet files.

REPORTING

Reports can be created in minutes showing live values, production totals, trend and event data, alarm summaries, etc. Customize reports with your own logos and graphics. Call up reports on demand, or have them automatically transferred to your computer.

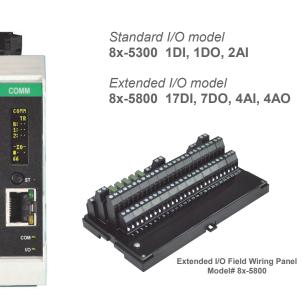

Modulus Serial Communications Module

- 1 ETHERNET PORT
- 3 SERIAL PORTS (2 GENERAL PURPOSE AND 1 BUS PORT)
- 1 DISCRETE/HIGH-SPEED PULSE INPUT
- 1 DISCRETE OUTPUT (PROTECTED FET)
- 2 ANALOG INPUTS (OHMS/THERMISTORS)
- Extended I/O model 8x-5800 adds Field Wiring Panel with an additional:
- 16DI (OPTO), 5 DO (RELAY), 2 AI (20MA), 4AO (20MA)

ALARMING

A serial communications module can manage alarm conditions on any of it's local inputs, as well as over 500 conditions monitored by communications with other devices. Alarms conditions can be displayed locally and annunciated with its discrete output, as well as with a Modulus Cellular Communications module (or text message and e-mail alerts. The module maintains a journal spreadsheet file of when alarms occurred, when they were acknowledged, by whom, and when the alarm conditions cleared.

PROGRAMMABLE LOGIC

Serial communications modules support programmable logic written in ladder logic, function block and text languages; all with 32-bit and floating point math. Programmable logic can supplement the built-in functions of the module.

PID & PUMP CONTROL

Serial communications modules have a quad PID controller and a triplex pump controller (float or level control) with error detection and alarming. Without requiring any additional modules, the Serial Communications Module is an ideal solution for efficient operation of wells, lift stations, and booster pump stations.

REDUNDANCY

Serial communications modules support redundancy for enhanced reliability. If a module goes off-line, a designated backup can take over automatically.



Modulus Serial Communications Module - 1120R Specifications

moduluo oomu			
STANDARD FIELD I/O Digital Inputs: Input Range: Input Current: Filtering	1 Non-isolated DC or contact closure, DC to 20KHz maximum Contact closure/open collector driver to ground, or 0 to 30Vdc (ON=<1.5V, OFF > 2.5V), 60Vdc absolu Approximately 0.5mA (internal current source) Individually configurable: 5Hz, 10Hz, 20Hz, 50Hz, 100Hz, 500Hz, 1KHz, 2KHz, 5KHz, 10KHz+	te maximum	
Digital Outputs:	1 Solid-state Protected FET high-side driver (switches to input power when ON)		
Output Rating:	30Vdc, 2A maximum, current limited to approximately 2.25A.		
Analog Inputs:	 2 16-bit, Delta Sigma, selectable input ranges 50K ohms Thermistor - 2.2K, 10K (type II, III and 11.K shunt) 		
EXTENDED FIELD I/O [8x	-5800] (adds to the above with I/O terminations on Field Wiring Panel with 24" cable)		
- Digital Inputs:	16 Optically Isolated, bipolar (AC/DC, not polarity sensitive)		
I/O Range: I/O Current:	0 to 30V (OFF < 6V, ON>9V), 60V absolute maximum 1.2mA @ 12V, 3mA @ 24V		
Filtering	Individually configurable: 5Hz, 10Hz, 20Hz, 50Hz, 100Hz, 500Hz, 1KHz, 2KHz+		
Digital Outputs: Contact Output Rating:	5 Relays, Form A (normally open) Dry Contact- Relays purchased and installed separately as needed (int 250 Vac, 30Vdc, 5A maximum per output (resistive load).		
Analog Innuta	A snubber diode (DC) or RC snubber (AC) must be used across the relay contacts or load connections	for any inductive load.	
Analog Inputs: Input Range:	 2 16-bit, Delta Sigma, individually selectable input ranges 20mA (minimum input for full accuracy is 0.5mA) 		
Maximum signal level	35Vdc on any range		
Analog Outputs	4 12-bit		
Output Ranges:	0 to 20mA		
COMMUNICATIONS			
Ethernet:	1 10/100mb/s (10/100 Base-T)		
SCADA Protocols	Modbus TCP & UDP (master/slave), Ethernet IP (master/slave PLC5 & SLC5/05 emulation), Ethernet to		
Internet Protocols Serial:	 HTTP (server), FTP (server & client), ICMP (ping; server & client), NTP (client), DHCP (server & client), RS-232, RS-485, RS-422, SDI-12 (COM1 - general purpose communications port.) 		
•••••	 1 RS-232, RS-485, RS-422 (COM2 - general purpose communications port.) 		
	1 RS-485 Bus port (this port is available for general purpose communications if not used for high-speed b	us communications with other modules)	
Baud Rates Protocols	115K, 38.4K, 19.2K, 9600, 4800, 2400, 1200 baud Modbus RTU (master/slave), DF1 (slave), SDI-12 (1st general purpose serial port only)		
HMIs			
Local:	128x32 graphical, wide temperature range yellow OLED and single pushbutton Web based, graphic library included. Compatible with most browsers, including, Internet Evolorer, Eirefox, Chrome, Safari, Android		
Graphical: Mobile:	Web based, graphic library included. Compatible with most browsers, including Internet Explorer, Firefox, Chrome, Safari, Android Web based, text only, up to 50 registers. Compatible with most browsers, including Internet Explorer, Firefox, Chrome, Safari, Android		
		inclox, onionic, outan, Android	
PROGRAMMING Languages:	Ladder Logic, Function Block, Text—built-in web based graphical and text editor and debugger		
Capacity:	64KB logic, 2MB source code, 32-bit integer and floating point math		
STORAGE Registers:	504 Numeric registers, 504 Boolean registers		
Internal Flash disk:	64MB		
Removable disk:	Micro SD Card (up to 256GB, supplied by customer)		
CLOCK Real Time Clock:	Temperature compensated with lithium battery backup power		
Stability	+/- 3ppm from -30° C to 70° C		
GENERAL			
Input Power:	10Vdc to 30Vdc		
Power Consumption			
Not using Ethernet	18mA @ 12Vdc / 14mA @ 24Vdc (Ethernet power saver enabled)		
Using Ethernet	60mA @ 12Vdc / 35mA @ 24Vdc		
+ current per relay ON	10mA @ 12Vdc / 5mA @ 24Vdc (extended I/O only)		
Field Wiring Termination:	[81-5300, 81-5800] screw terminal blocks [82-5300, 82-5800] lever terminal blocks, 3.5mm, 22 to 14G	A wires	
	[81-5800, 82-5800] Added I/O on Field Wiring Panel: 2-tier, 5.08mm screw terminal blocks, 22 to 14GA	wires	
Temperature:	-40°C to 70°C (operating), -40°C to 85°C (storage)	82-xxxx Lever Terminals	
Humidity:	<95% RH (non-condensing)	400	
Enclosure:	Polyamide, light gray (RAL 7035)	and the sec	
Mounting:	35mm DIN rail with bus connector block	81-xxxx Screw Terminals	

Specifications subject to change without notice. Consult factory to ensure that you are working with current information.


Modulus Serial Communications Module - 1120R DIMENSIONS and WIRING

DIMENSIONS and WIRING

-0.9" 00000 COM2 COMM 00000 COM1 O ST 🗆 TB1 сом 🗖 0 10 🗆 700000TB1 terminals Inputs/Outputs Termina Function -485 DI1 2 +485 2 AI1 Al2 3 RESET# 3 D01 4 GND 4 5 ±\/ 5 GND

Refer to the installation manual for additional installation details and precautions.

DISCRETE & ANALOG INPUTS/OUTPUTS-TB1



All discrete and analog inputs/ outputs are referenced to the ground terminal (5). This terminal is connected internally to the modules power supply ground.

The Discrete Input accepts a contact closure or open-collector ("NPN" style) input signal. An external pull-up resistor is not required.


The Discrete Output sources current ("PNP" style) from the modules input power.

The Analog Inputs support resistive sensors such as potentiometers and thermistor temperature sensors up to 50,000 ohms. 2252 ohm thermistors are generally recommended for the greatest temperature range.


Contact ICL Customer Service for available pre-wired Field Wiring Panel


Extended I/O Wiring (8x-5800) shown on back page

General Purpose Communications Ports COM1 and COM2 (modes are software configured)



Typical COM1/COM2 RS-232 Wiring to Modem/Radio







The Analog Ir tive sensors s

Modulus Serial Communications Module - 1120R Rev A5 Copyright © 2017 Industrial Control Links, Inc. All Rights Reserved Industrial Control Links, Inc. 1364 Blue Oaks Blvd., Roseville, CA 95678 530.888.1800


Extended I/O Field Wiring Panel 8x-5800

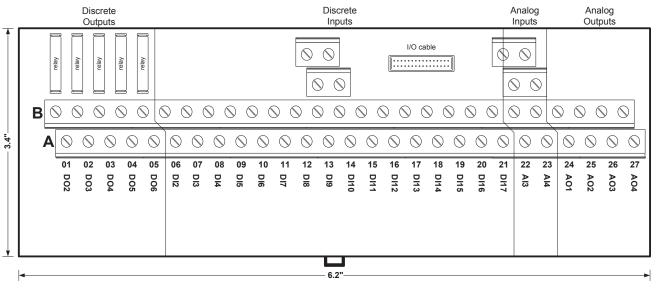







Discrete Inputs Wiring

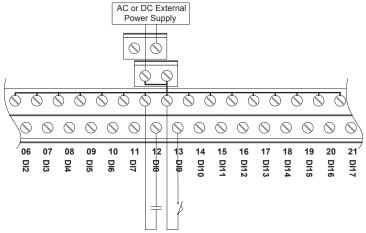


Analog Inputs Wiring Loop Powered Devices



Analog Inputs Wiring Self Powered Devices



Analog Outputs Wiring





Refer to the installation manual for additional installation details and precautions.

Industrial Control Links, Inc. 1364 Blue Oaks Blvd. Roseville, CA 95678 530.888.1800